



NOTES:

1. LES RECOMMENDS METERS BE INSTALLED ABOVE TVA "RISK PROFILE ELEVATION" OR THE "500-YEAR FLOOD LEVEL"
2. CUSTOMER IS RESPONSIBLE FOR THE FULL COST OF REPLACING A METER DAMAGED BY FLOODING
3. ALL CUSTOMER-SIDE WIRING MUST MEET THE STATE OF TENNESSEE WIRING CODE AND THE NATIONAL ELECTRIC CODE (NEC) AS DETERMINED BY THE STATE OF TENNESSEE ELECTRICAL INSPECTOR.
4. LES WILL NOT INSTALL, OWN OR MAINTAIN UNDERGROUND FACILITIES INSIDE FLOOD PLAINS.
5. A PLATFORM MUST BE PROVIDED IF THE METER IS MOUNTED MORE THAN 5.5’ ABOVE GROUND LEVEL.
6. PLATFORM CONSTRUCTION MUST COMPLY WITH THE STATE OF TENNESSEE ELECTRICAL INSPECTOR’S REQUIREMENTS
7. PLATFORM MUST BE SELF-SUPPORTING AND SHALL NOT USE THE LES POLE FOR SUPPORT.
8. THE CUSTOMER IS REQUIRED TO MAINTAIN THE PLATFORM IN A SAFE CONDITION.
9. SERVICE, METER AND STAIRS TO FACE TOWARDS THE PROPERTY TO BE SERVED.

MATERIALS:

- A. PLATFORM TO BE OF PRESSURE-TREATED WOOD OR OTHER (TN STATE INSPECTOR APPROVED) WEATHER-RESISTANT MATERIALS
- B. ALL CONDUIT TO BE 2" RIGID NON-METALLIC SCHEDULE 80 (CUSTOMER SUPPLIED)
- C. WEATHERHEAD TO BE NON-METALLIC (CUSTOMER SUPPLIED)

REVISION	DATE	CHANGE DESCRIPTION	ECO NUMBER	ENGINEER
08	09/04/26	REVISE AND REDRAW	0013	ROGERS

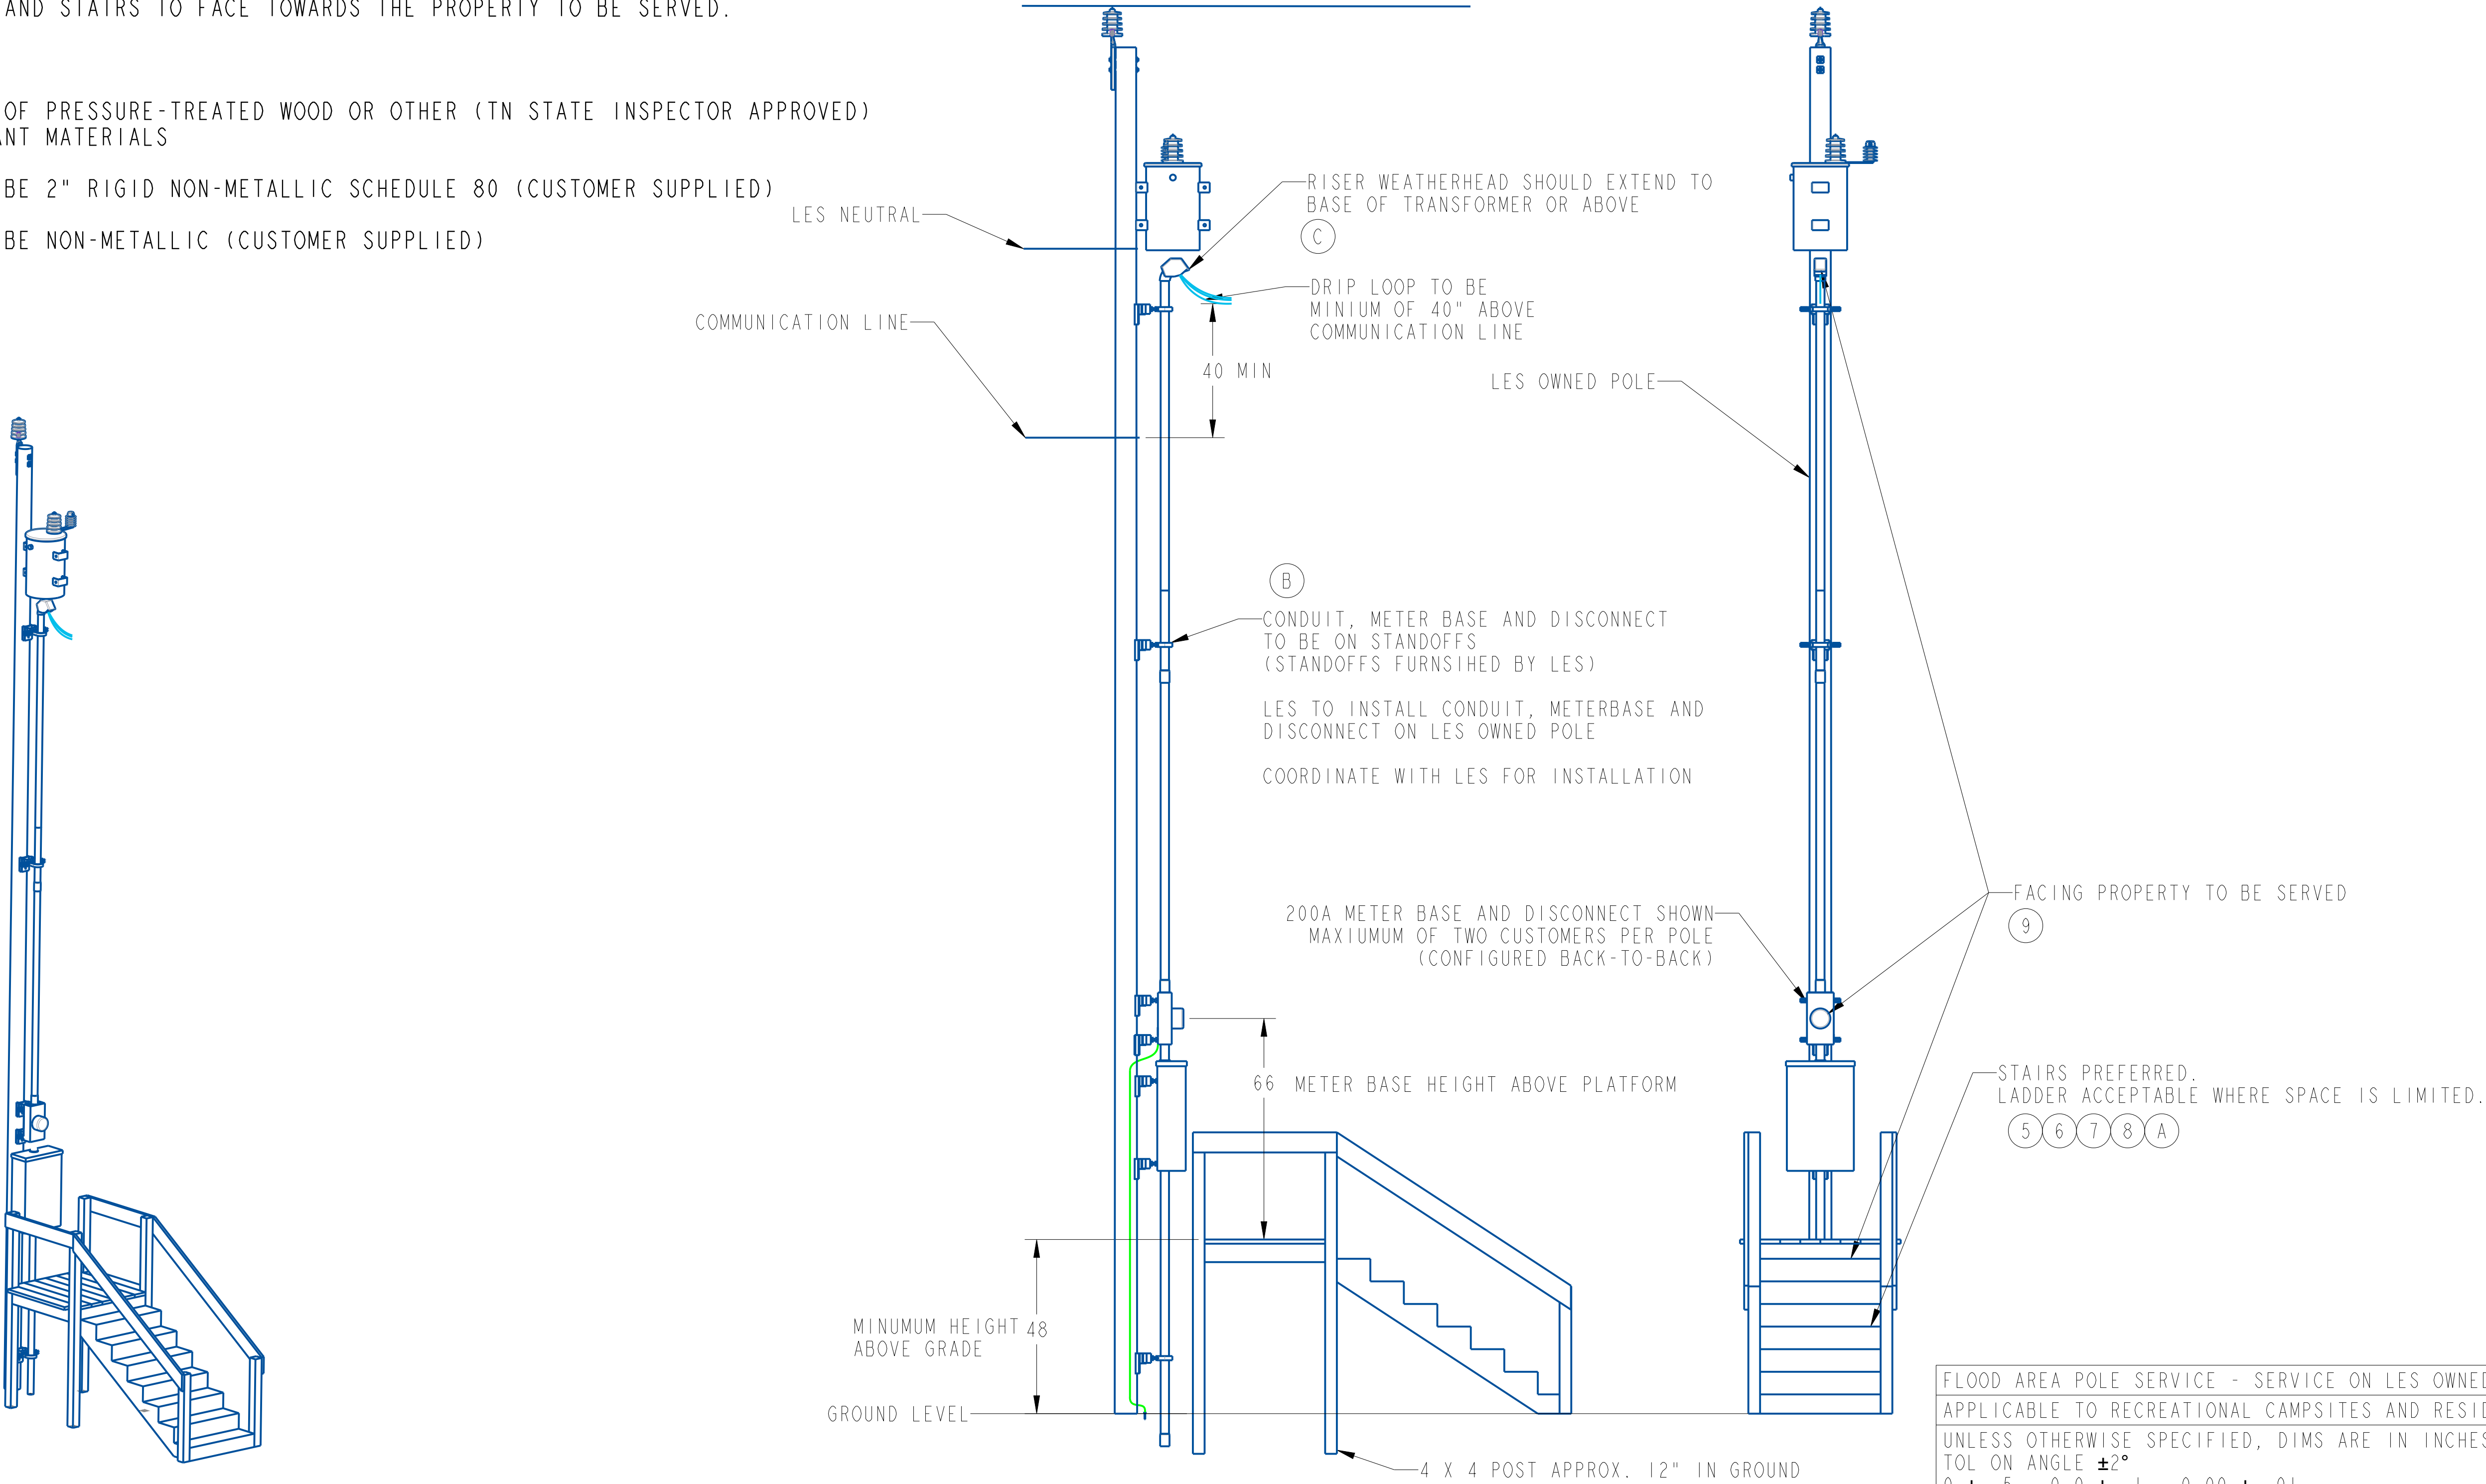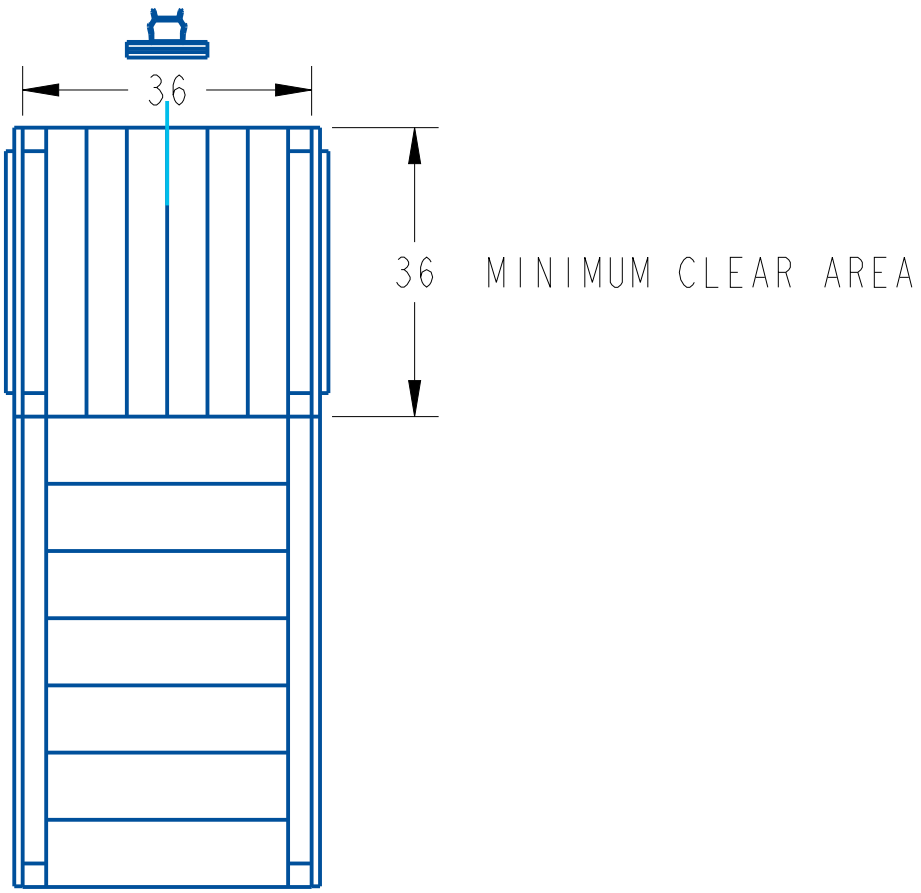

FLOOD AREA POLE SERVICE - SERVICE ON LES OWNED POLE			
APPLICABLE TO RECREATIONAL CAMPSITES AND RESIDENTIAL, FLOOD PRONE AREAS			
UNLESS OTHERWISE SPECIFIED, DIMS ARE IN INCHES			
TOL ON ANGLE	±2°		
0 ± .5	0.0 ± .1	0.00 ± .01	