





PRIMARY UG CONDUIT REQUIREMENTS

NOTES:

- 1) LES MUST INSPECT DITCH BEFORE BACKFILLING
- 2) MINIMUM 36" COVER OVER LES PRIMARY
- 3) RED WARNING TAPE REQUIRED AT APPROXIMATELY 12" ABOVE LES CONDUIT (LES WILL SUPPLY TAPE)
- 4) 12" DELIBERATE SOIL SEPARATION BETWEEN A COMMUNICATIONS CONDUIT IN SAME DITCH
- 5) 12" DELIBERATE SOIL SEPARATION BETWEEN A WATER LINE IN SAME DITCH
- 6) CONSULT GAS UTILITY FOR DELIBERATE SOIL SEPARATION REQUIREMENT BETWEEN GAS LINE AND LES CONDUIT IN SAME DITCH
- 7) LES WILL PROVIDE STANDOFFS ON POLE
- 8) PULL STRING REQUIRED IN CONDUIT FOR LES TO PULL IN A PULLING ROPE
- 9) COMMUNICATIONS CONDUIT/CABLE CAN NOT BE PLACED INSIDE A LES PULL BOX OR TRANSFORMER
- 10) SCHEDULE 80 CONDUIT REQUIRED ABOVE GROUND AND UNDER SIDEWALKS, CONCRETE, AND DRIVEWAYS
- 11) SCHEDULE 80 LONG-SWEEPELLS REQUIRED AT TAKE-OFF POLE
- 12) CUSTOMER MUST SUPPLY AND HAVE ON-SITE SCHEDULE 80 CONDUIT FOR LES TO INSTALL UP THE POLE
- 13) CUSTOMER IS RESPONSIBLE FOR DETERMINING IF ANY STREAMS, CREEKS, OR DITCHES ARE "BLUE LINE". IF DEEMED "BLUE LINE", THE CUSTOMER WILL HAVE TO OBTAIN A CROSSING PERMIT FROM TDEC TO SUPPLY FOR LES' FILES.
- 14) CUSTOMER WILL PROVIDE ALL CONDUIT
- 15) CUSTOMER HAS OPTION TO INSTALL PRIMARY UG CONDUIT. CUSTOMER MAY INSTALL 3" RIGID PVC SCH 80 STICKES OR ALTERNATELY MAY SUPPLY 2 1/2" SCH 40 ROLL CONDUIT (STUART IRBY PART# 3565650) SEE LES FOR MORE INFORMATION

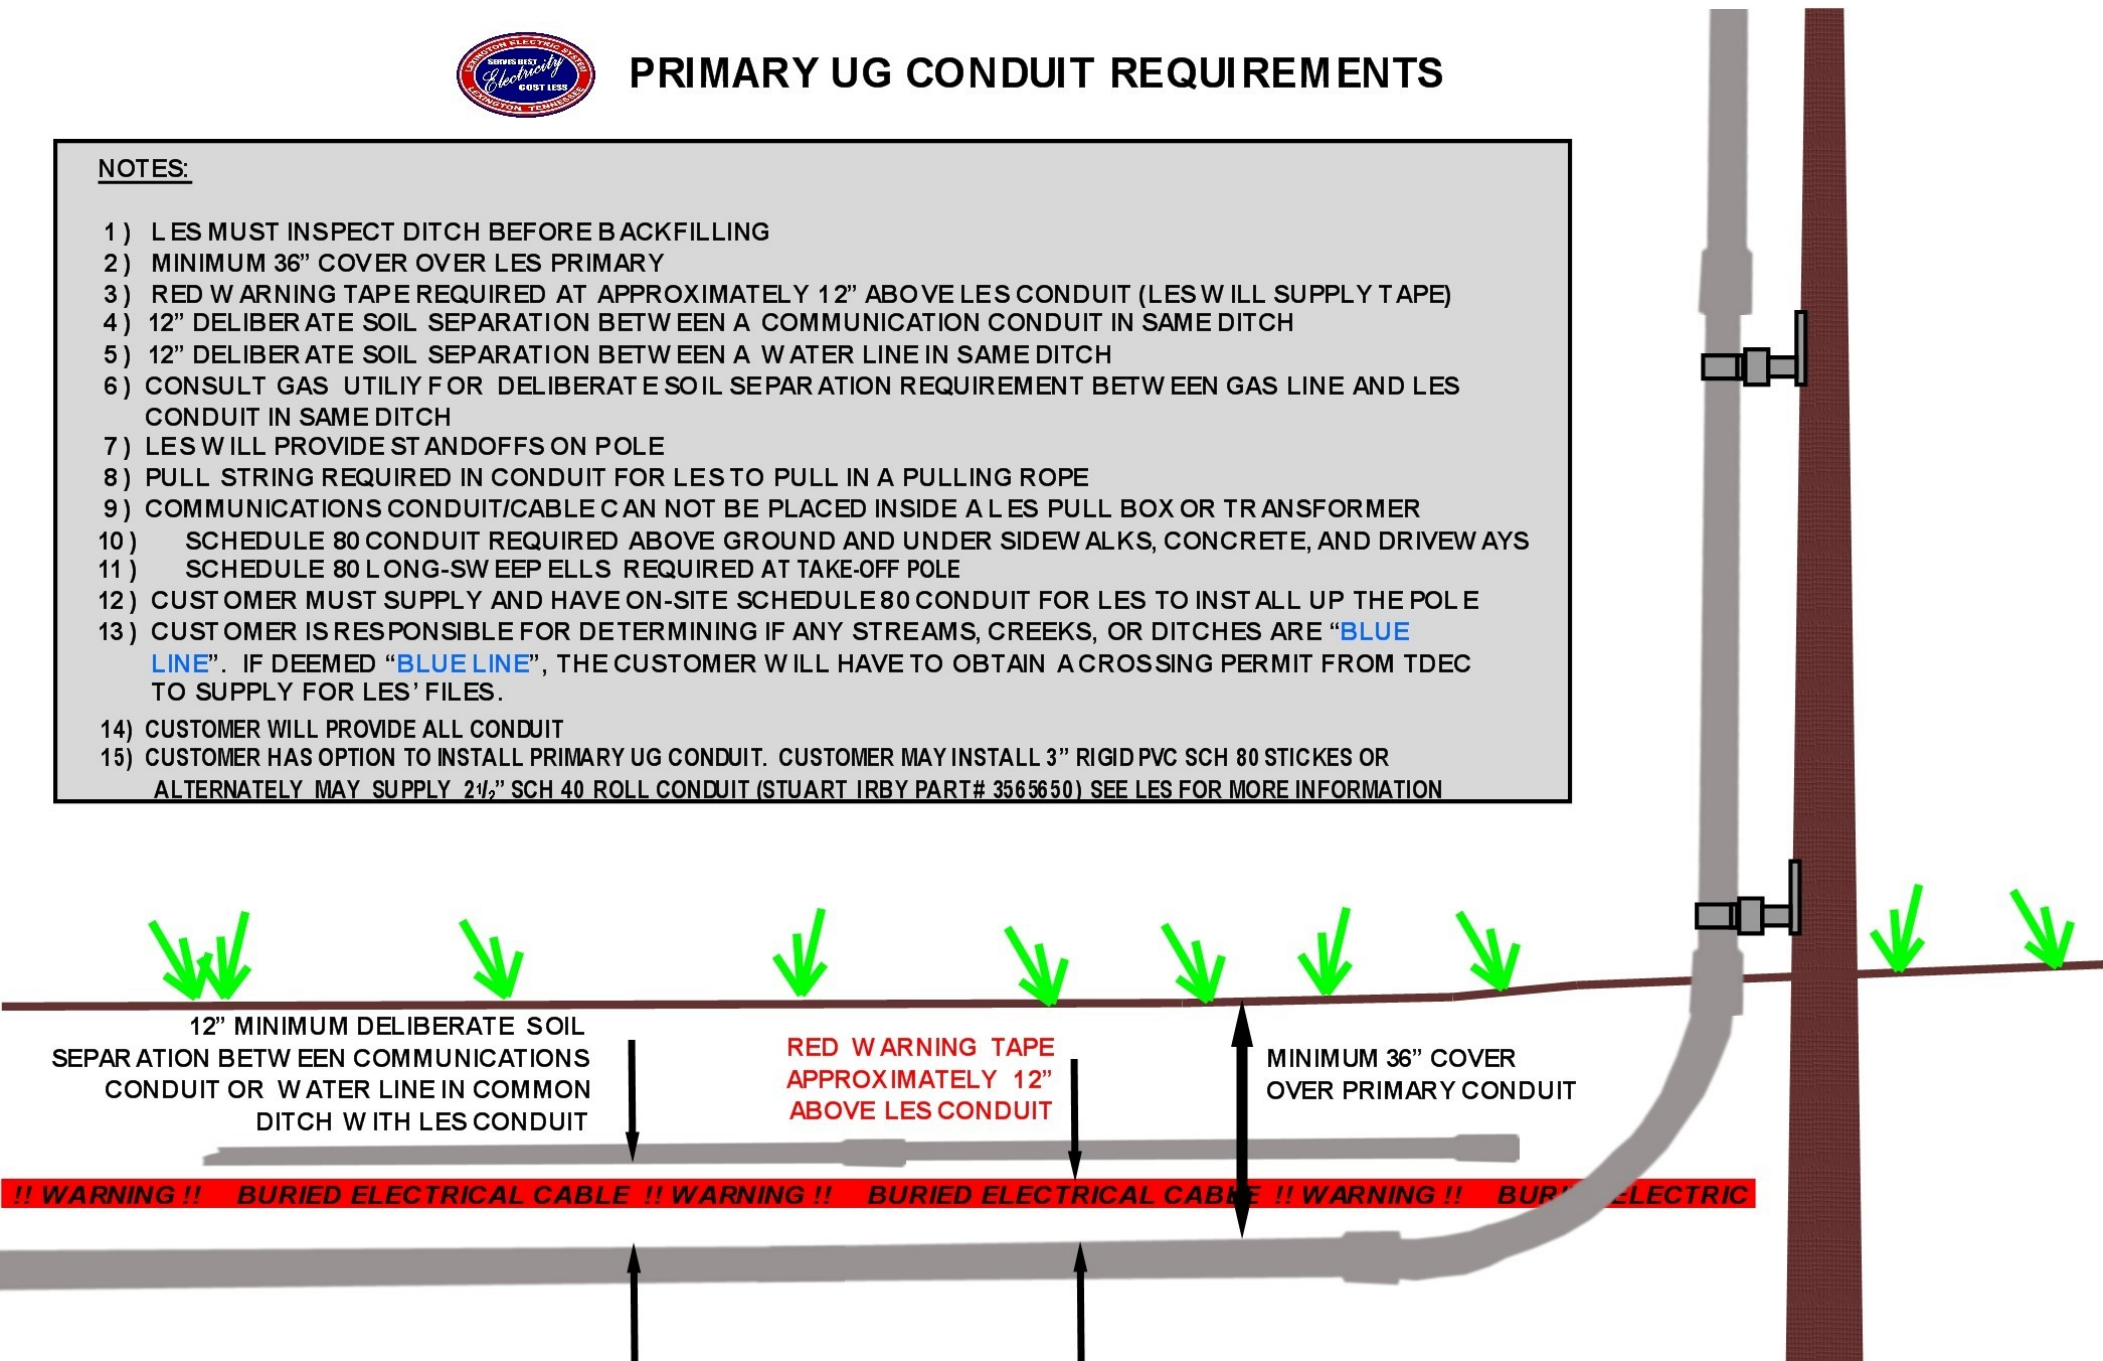

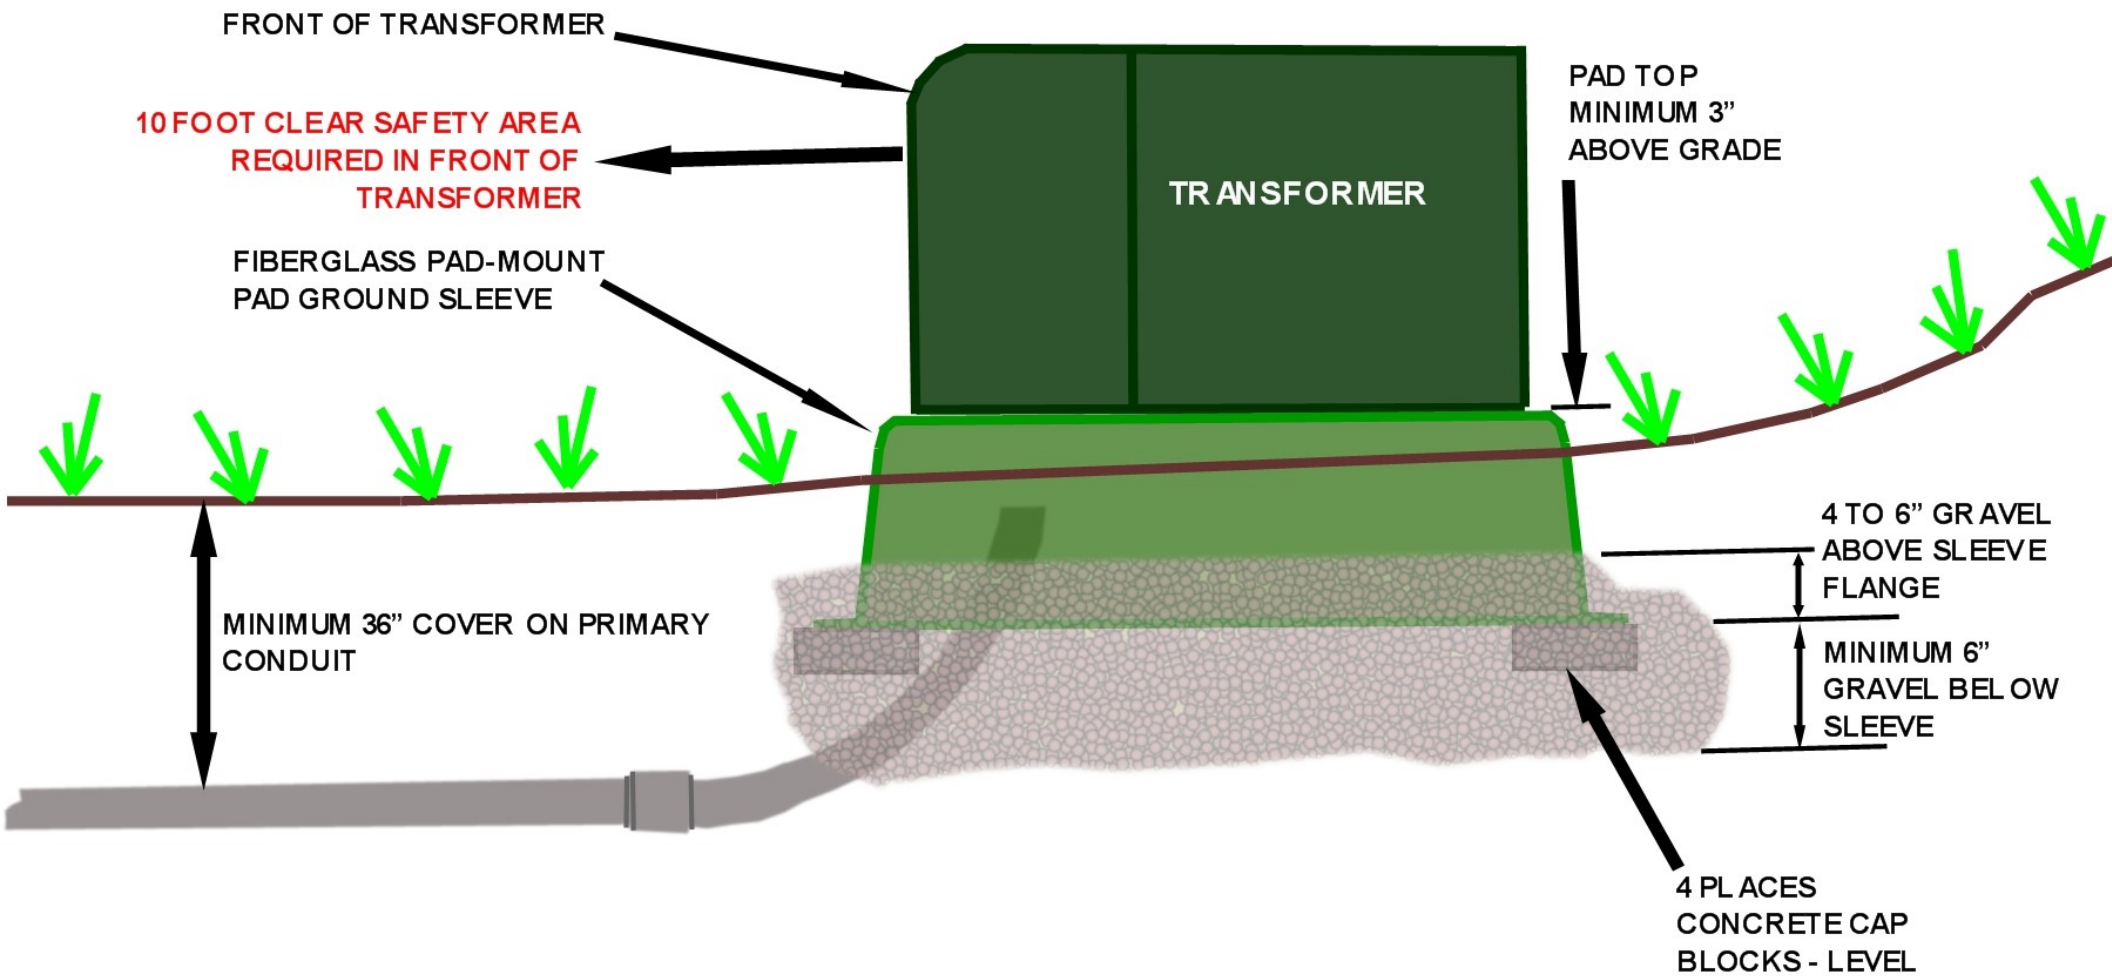



FRONT OF SECTION ALIZER PEDESTAL

10 FEET CLEAR SAFETY AREA
REQUIRED IN FRONT OF
SECTIONALIZER

PAD TOP
MINIMUM 3"
ABOVE GRADE

FIBERGLASS
GROUND
SLEEVE

MINIMUM 36" COVER
ON PRIMARY CONDUIT

4 TO 6" GRAVEL
ABOVE SLEEVE
FLANGE

MINIMUM 6"
GRAVEL BELOW
SLEEVE

CONCRETE CAP
BLOCKS - LEVEL
(4 PLACES)

